


Water Supply Analysis Graph

Assisi Aged Care

230 Rosanna Road
Rosanna

Calculation Information: l/min kPa
Array (01) Demand
Ground Floor New Extension 323 @ 272

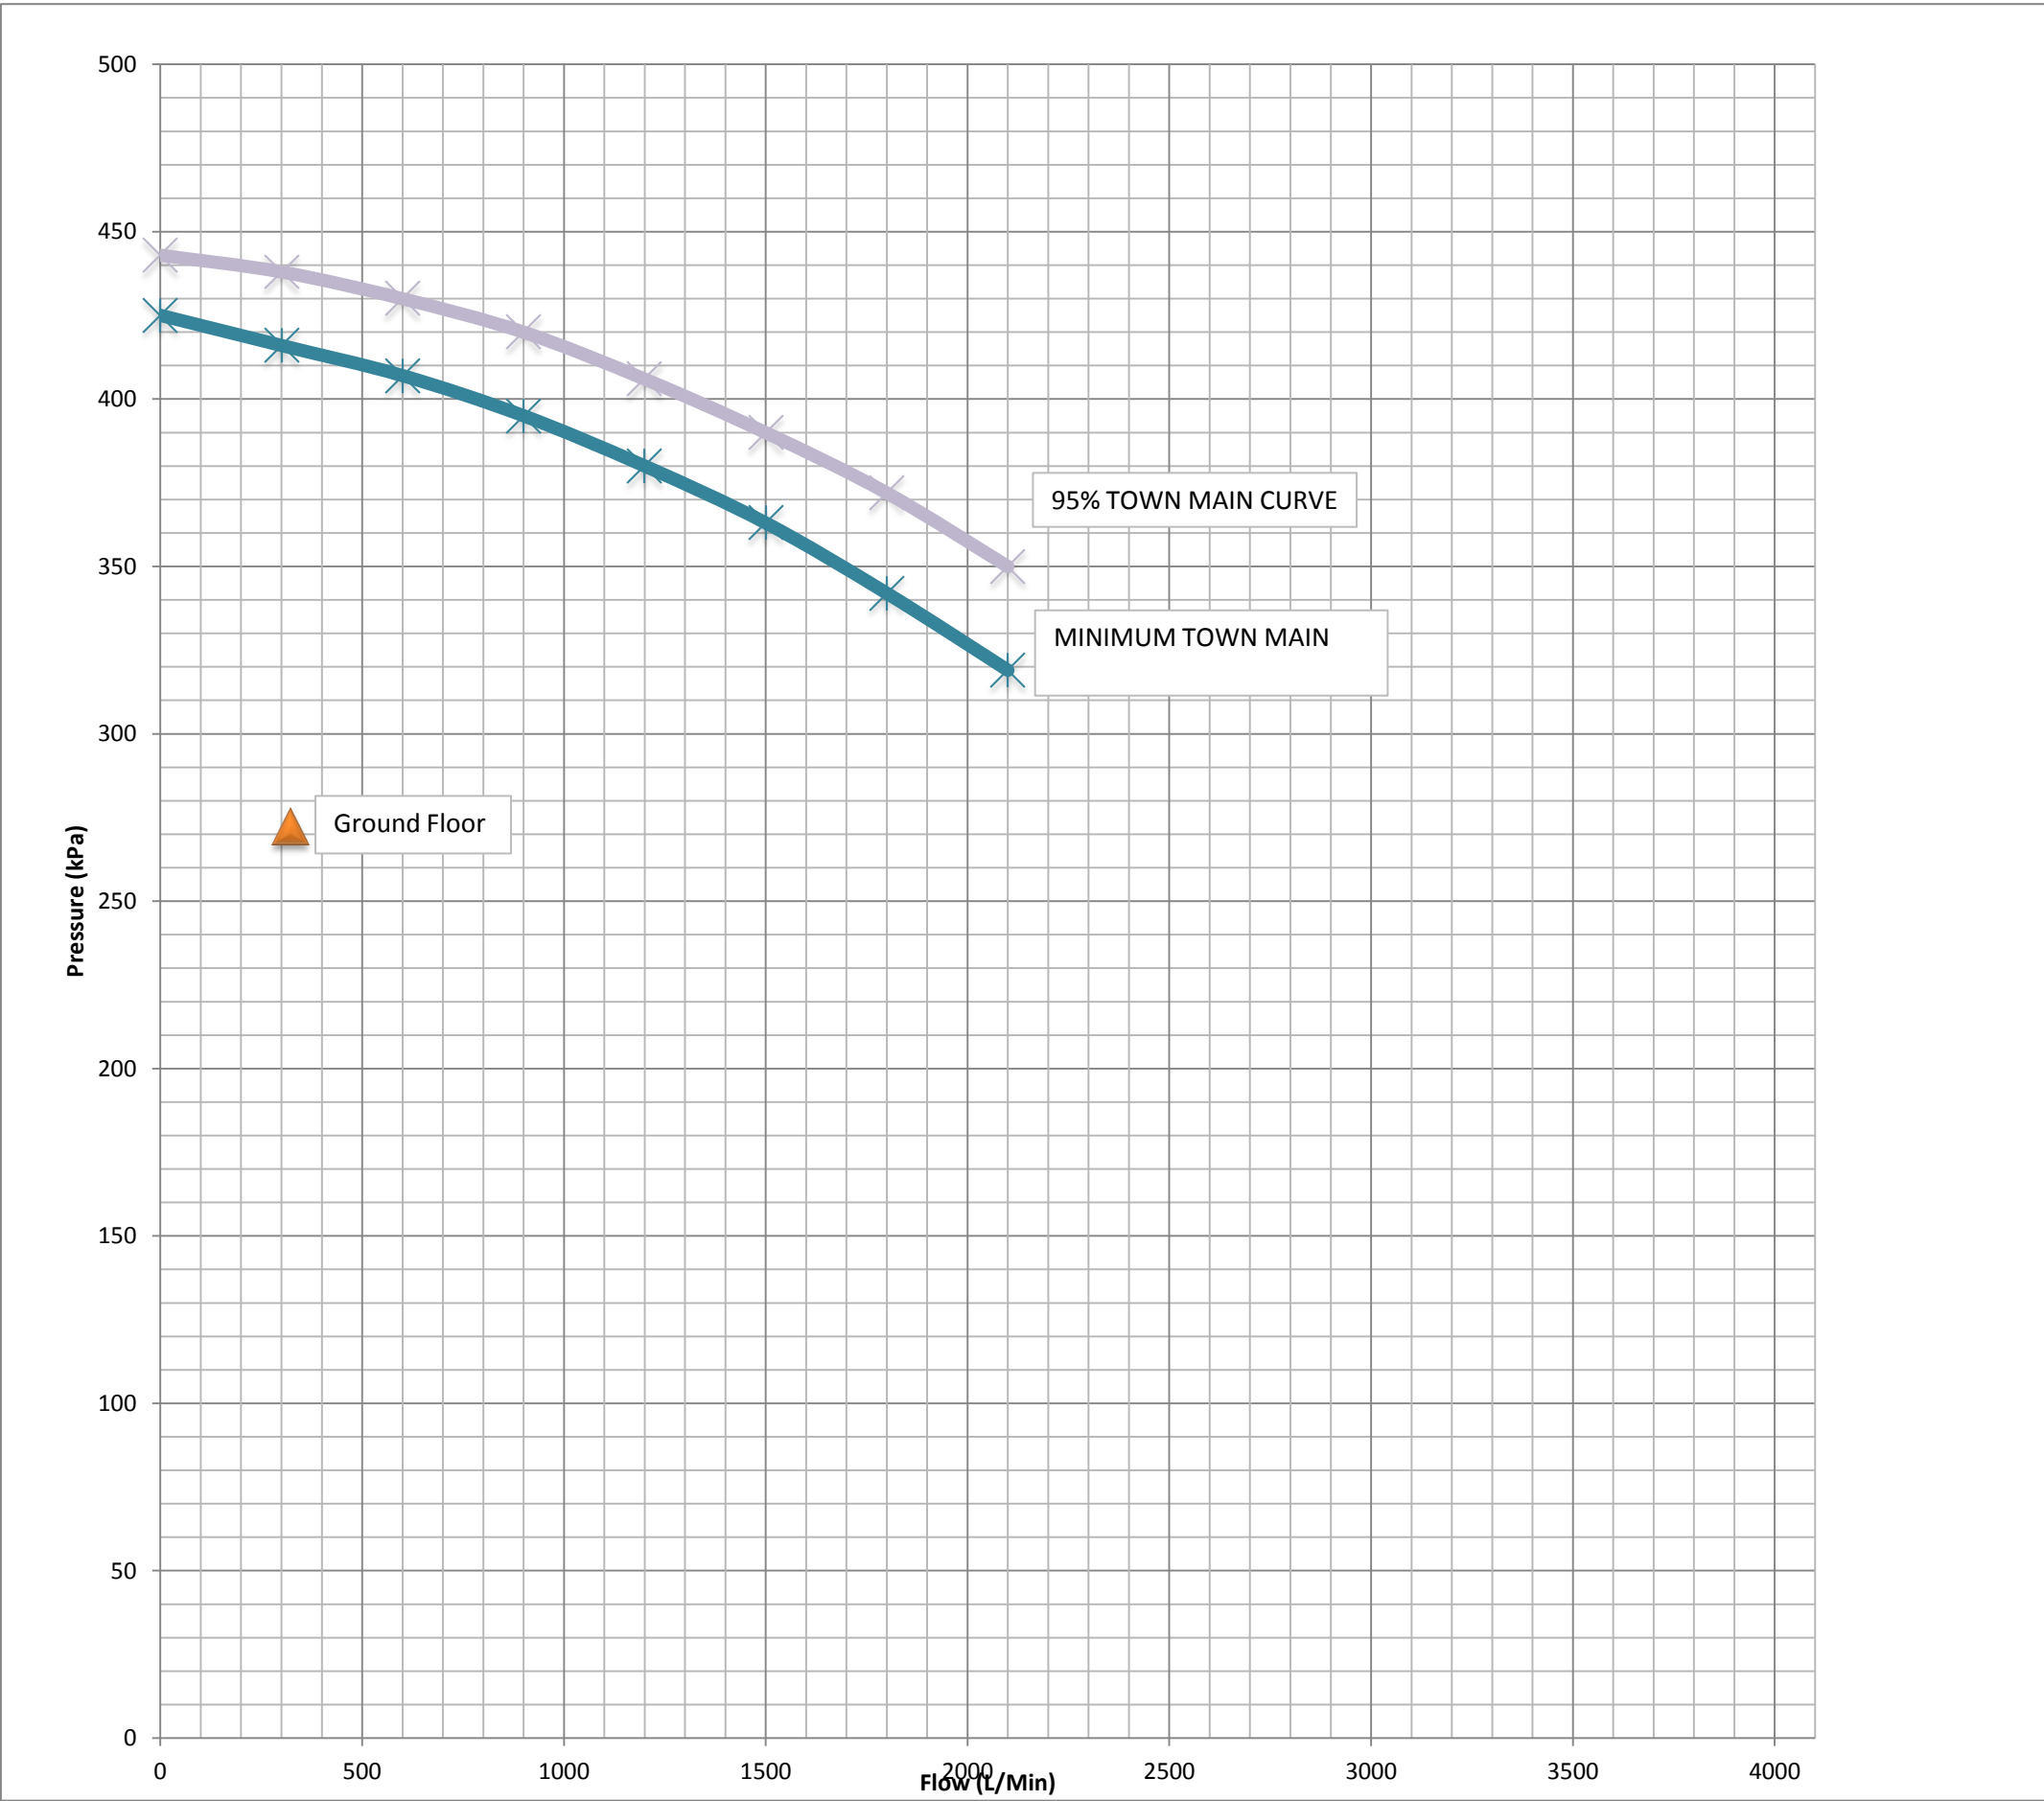

TOWN MAIN RL = 70.0
CONTROL VALVE RL = 67.50

AUTHORITY - YARRA VALLEY
DATE - 31 MARCH 2012
REF - 8-50056917

Rapid Fire Prevention