


Water Supply Analysis Graph

Assisi Aged Care

230 Rosanna Road
Rosanna

Calculation Information:			
Array (01) Demand	l/min		kPa
Ground Floor New Extension	323	@	272
First Floor	312	@	252

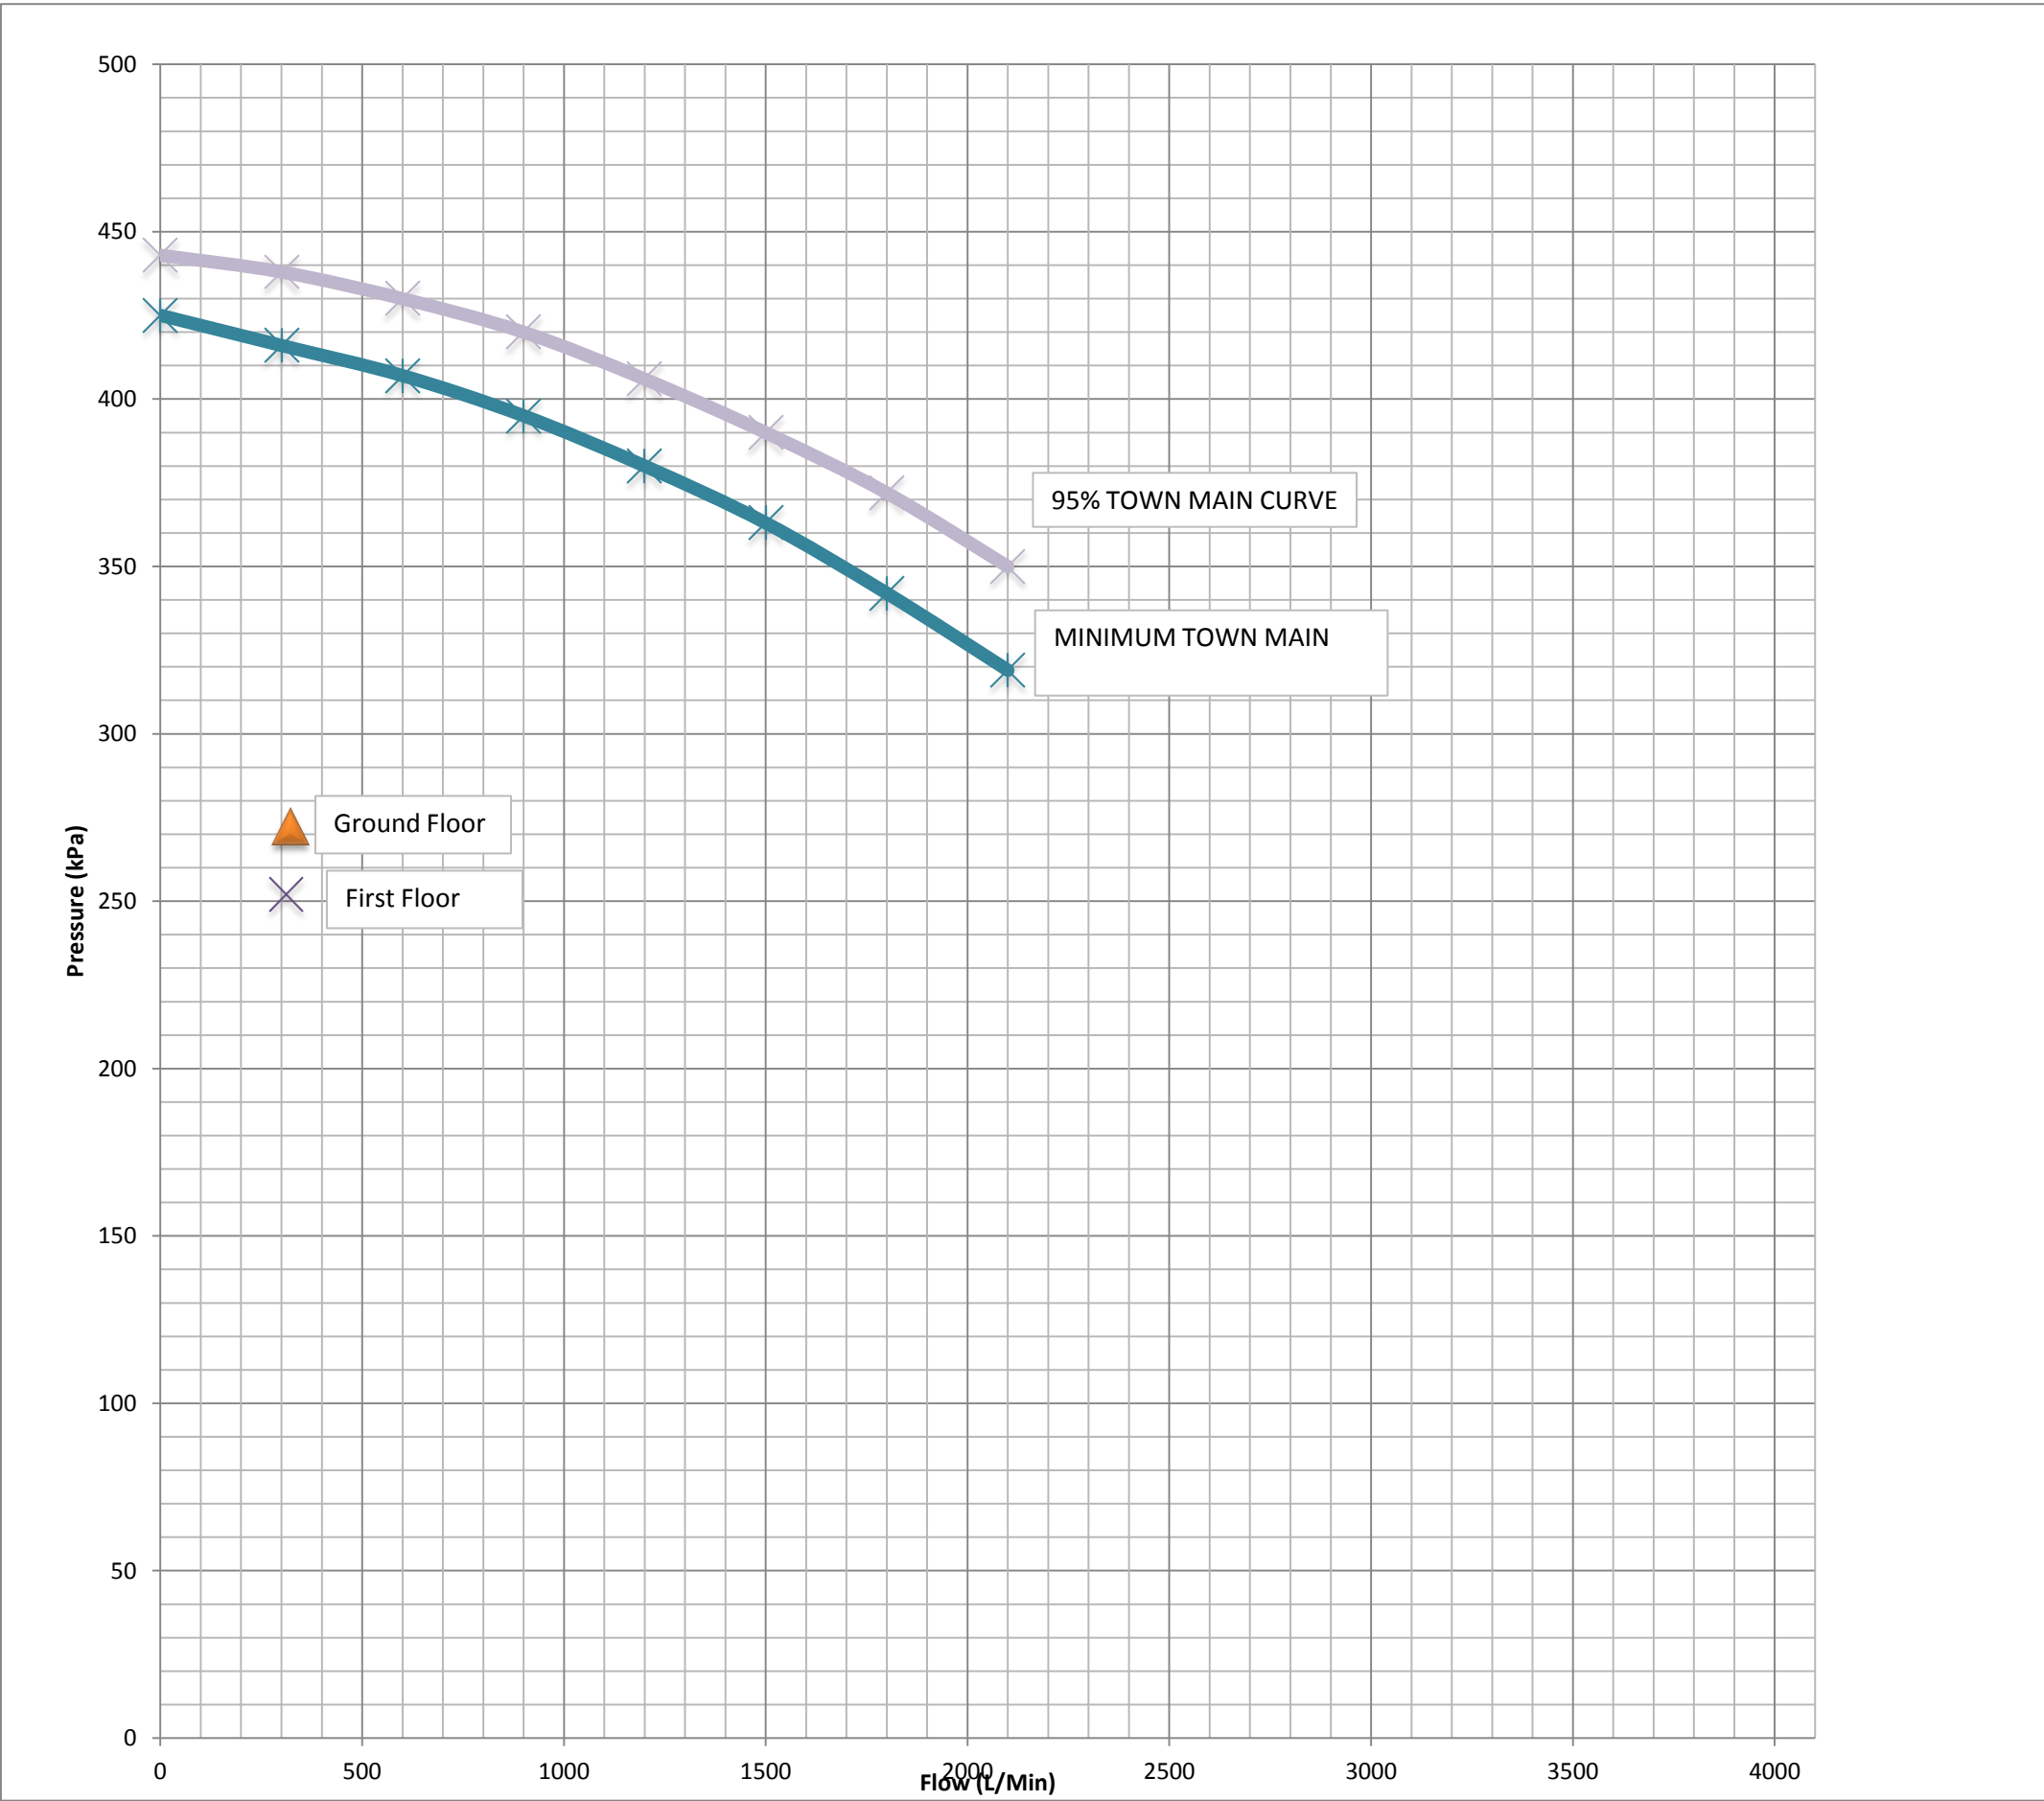

TOWN MAIN RL = 70.0
CONTROL VALVE RL = 67.50

AUTHORITY - YARRA VALLEY
DATE - 31 MARCH 2012
REF - 8-50056917

Revision A - 14 May 2012

Issue Date 26 April 2012

Rapid Fire Prevention

Prepared By N.Salt