


ASSISI CENTRE AGED CARE

230 ROSANNA ROAD, ROSANNA




ASSURED FIRE PROTECTION

P O BOX 213
GLEN WAVERLEY VIC 3160
PH: 0487 333 087

EMERGENCY INSTRUCTIONS

1. ASSIST ANY PERSON IF SAFE TO DO SO
2. TELEPHON EMERGENCY SERVICES - 000
3. ENSURE FIRE IS EXTINGUISHED
4. CLOSE MAIN STOP VALVE (Shutting off water supply)
5. OPEN WASTE VALVE (Draining installation).
6. REMAIN AT VALVES : IF FIRE RE-OCCURS ;
 - a) CLOSE WASTE VALVE &
 - b) RE-OPEN MAIN STOP VALVE.
7. TELEPHONE ASSURED FIRE PROTECTION
0487 333 087

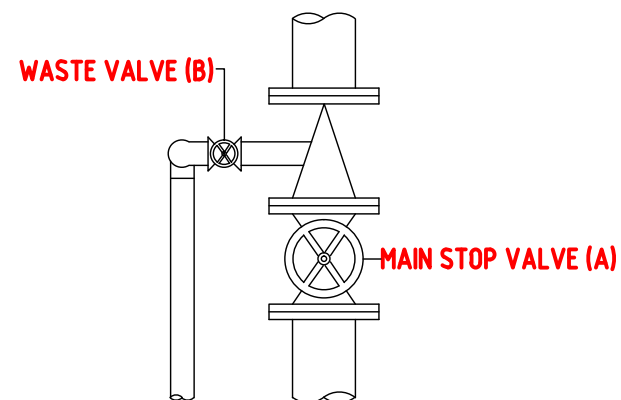


INSTALLATION DATE: JULY 2014

HIGHEST SPRINKLER: 5 Metres ABOVE SPRINKLER
CONTROL VALVE

DESIGNED IN ACCORDANCE WITH AS2118.4
RESIDENTIAL FIRE SPRINKLER SYSTEMS

SPARE SPRINKLERS LOCATED IN CABINET

SPRINKLER SYSTEM RESSURE/FLOW REQUIREMENT
= 312 l/min @ 252 kPa

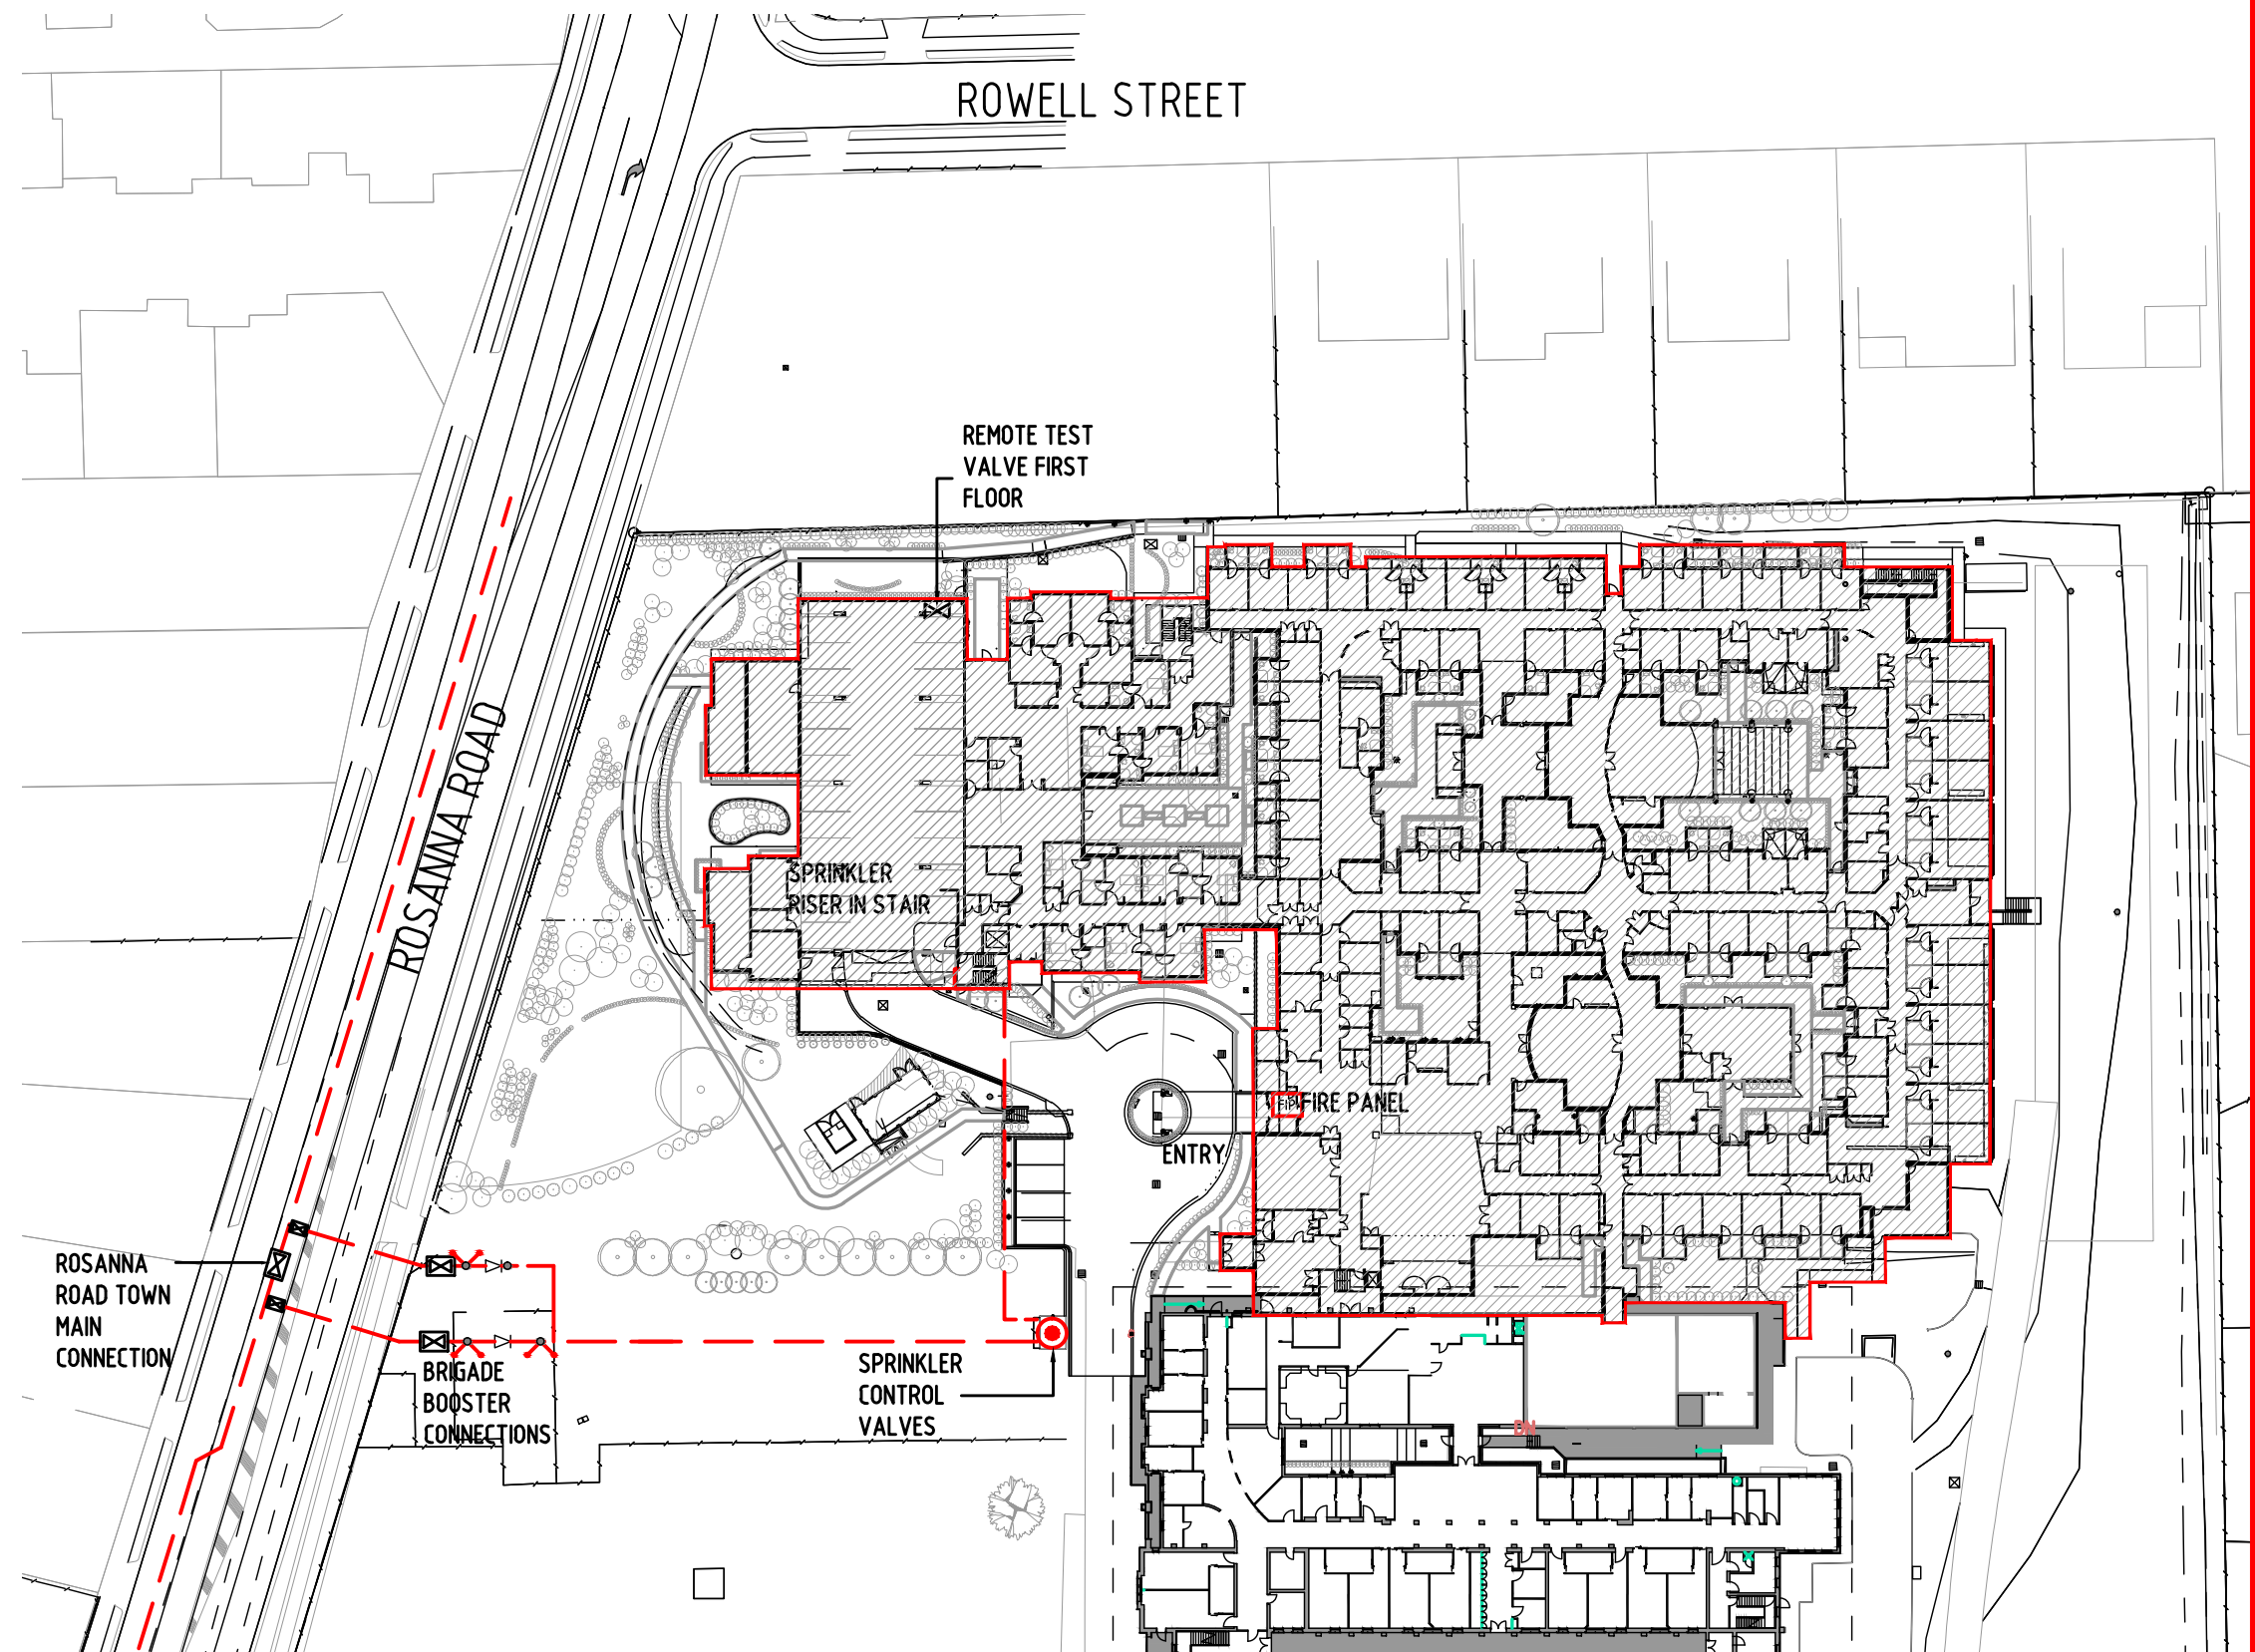

SITE PLAN 1:750